



# ***Residential PV Rooftop in India - Motivation and Quality Assessment***

**Rooftop PV systems Survey Results  
in cooperation with BSES Rajdhani Power Limited (BRPL)**



**Residential Rooftop Systems – Design and Quality Go Hand in Hand**

**December 6, 2017**

**Inter Solar Mumbai**



## Survey Objective

### Evaluation of the technical criteria for the 40 GW rooftop solar


- Which standard PV components are most suitable for the Indian roof-top market?
- What are the best practices measures to ensure a good and sustainable PV-performance under the local conditions?
- Why people opted for solar rooftop system?



**43% average annual electricity bill saved**

- **Pay back – 5 years without Subsidy**

Monthly reduction in electricity bill

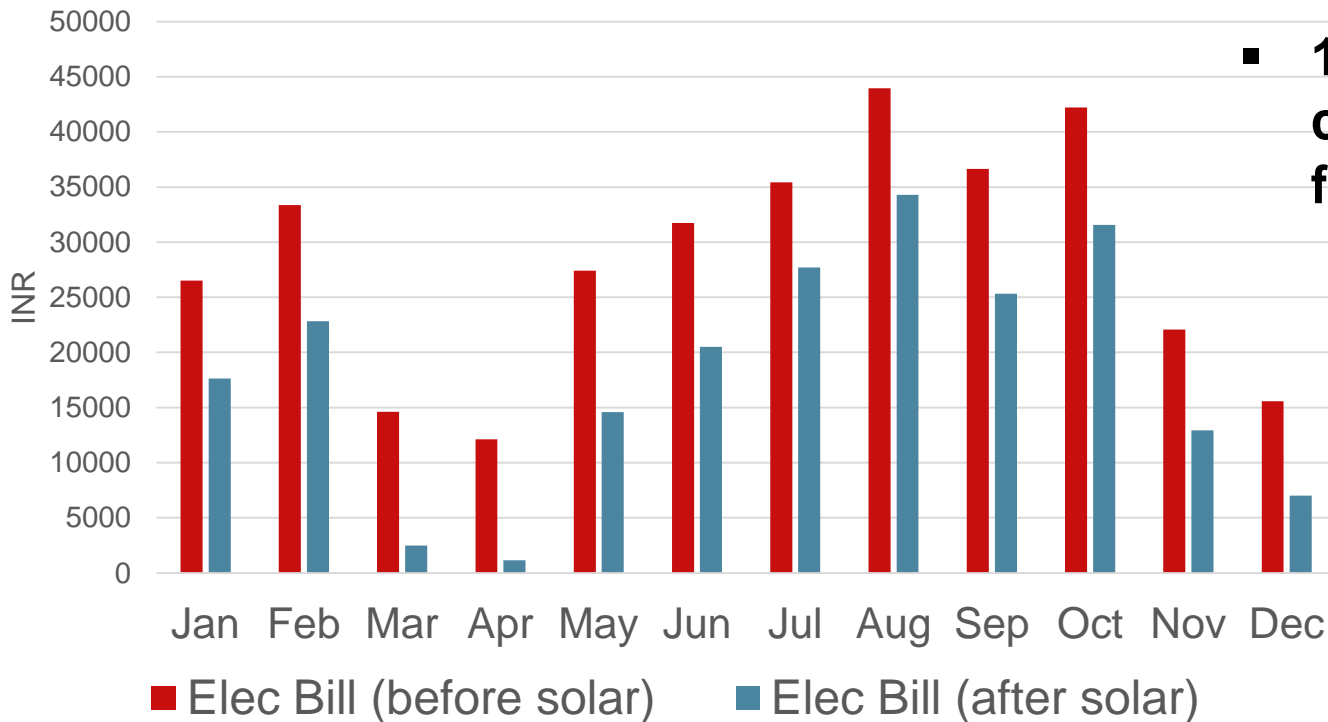

- **17% of the capital cost recovered in first year**



## Survey Approach

- Sample size 15 systems (3-120 kWp)

### Inspection on Site



1. Fast Check



2. Visual inspection of the roof-top PV-system




3. Electric inspection of the DC site



## Specific Yield of ~1400 for best performing and ~850 for worst performing system

→ System Performance significantly lower than indicated by simulations based on satellite data (~1800 kWh/kWp)

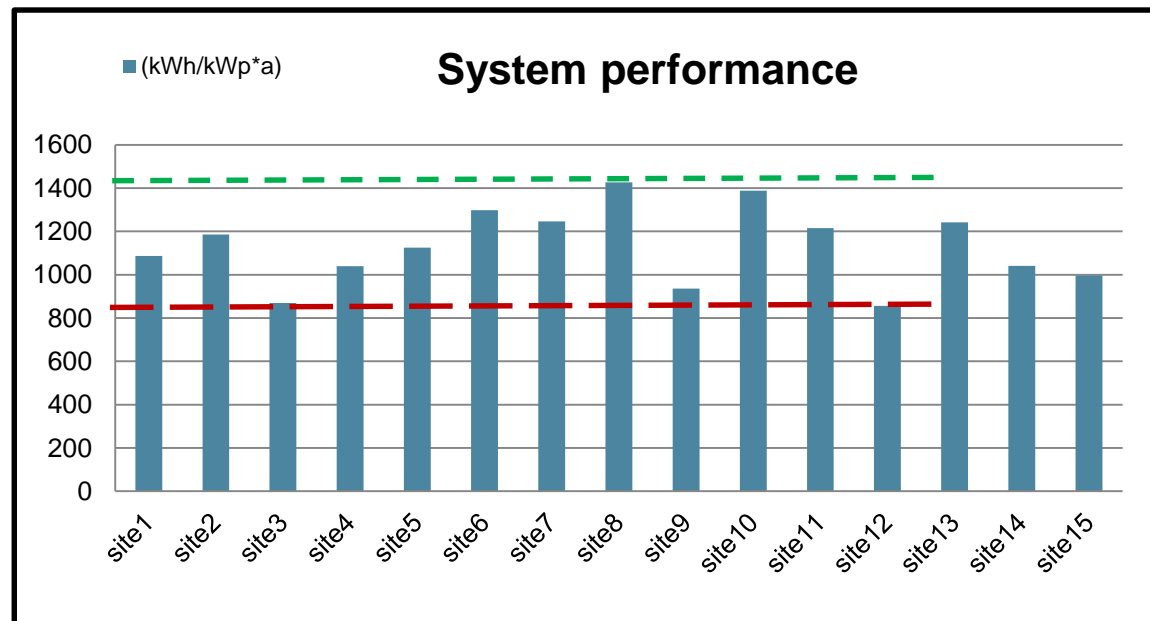

→ The highest yield is seen in the months of Feb to April and September



## Study Results: Key Findings

➔ Correlation between quality of the inverter, the cleaning frequency and the mounting structure and the system performance.

Ranking	Site	Monitoring system	Maintenance contract	European inverter	Installation on superstructure	Cleaning weekly	Privately owned
1.	Site 8	Green	Green	Green	Green	Green	Green
2.	Site 10	Green	Green	Green	Green	Green	Green
3.	Site 6	Red	Red	Green	Red	Green	Red
4.	Site 7	Green	Green	Green	Green	Red	Green



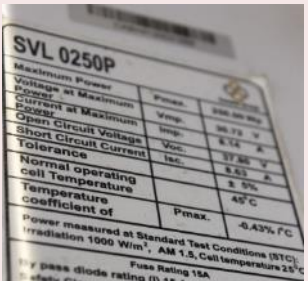


...

12	Site 15	Red	Red	Red	Red	Red	Green
13.	Site 9	*	Red	Red	Red	Red	Red
14	Site 3	*	Red	Red	Red	Red	Red
15 **	Site 12	Green	Green	Red	Red	Green	Green

\*Monitoring system was installed, but the interview showed that the owner did not sufficiently know how to handle the data. \*\* The owner was aware about the low performance of the system and intended to take measures to increase the performance.






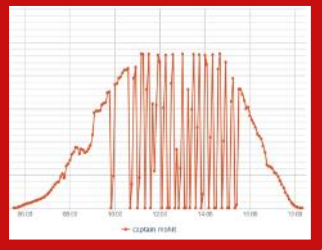

# Study Results: Planning

Choice of Module		Choice of Inverter		
Polycrystalline dominates	Unused glass-glass-technology	Lack of positive tolerance modules	Single MPP dominates	Top 5 use high end European inverter
				
Promote the use of monocrystalline modules	Educate on the advantages of glass-glass-module technology	Raise awareness towards benefits of positive power tolerance	Train on the benefits of multiple MPP	Educate on the advantages of quality inverters






## Study Results: Planning

Mounting Structure			System Sizing	Grid Instabilities
Corrosive materials used	Shading	Multiple use of roofs	Unfavorable inverter sizing	High voltage fluctuations
				
Promote use of aluminum (freestanding) or gal. steel (Superstructure)	Train on the influence of shading on the performance	Promote the use of PV-Superstructures	<ul style="list-style-type: none"> <li>• Conservative DC to AC ratio of 90–110%</li> <li>• Use of sizing programs can help</li> </ul>	<ul style="list-style-type: none"> <li>• Adjustment of inverter settings</li> <li>• Net analyzing data logger</li> <li>• Reactive power control</li> </ul>







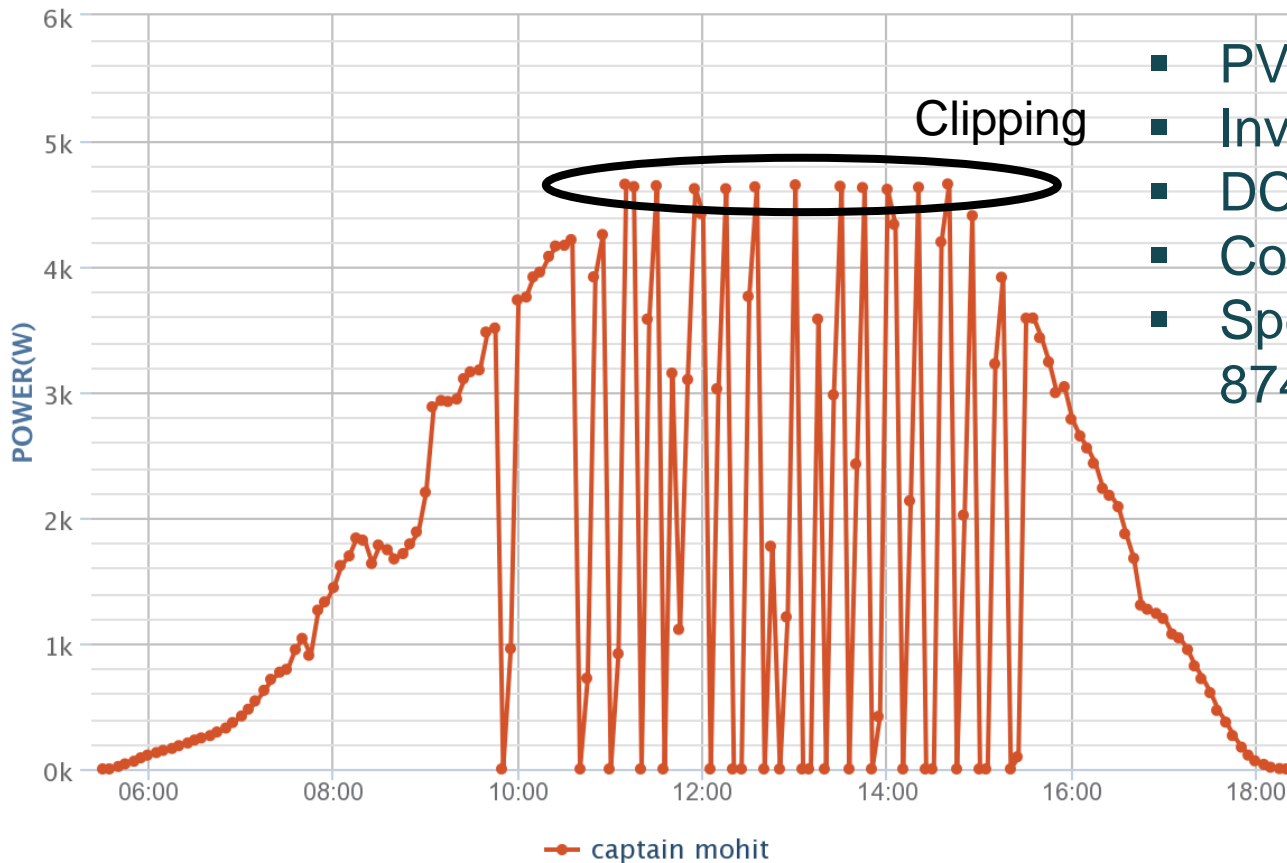


## Optimal Inverter Sizing



- PV size – 8kWp
- Inverter – 4.6 kW
- DC:AC - 173%
- Contracted load – 7kW
- Specific Yield = 874kWh/kW<sub>p</sub>



## Study Results: Installation

Components			Mounting Style	Cable Sizing
Breaking cable conduits	Non UV resistant cable ties	PV connectors and crimping tools	Usage of predrilled boreholes	Small diameters
				
Guidelines on material and positioning of conduits	Enhance the use of UV resistant cable ties	Promote tool less connectors or give incentives for regular crimping tools	Educate on the advantage of using module clamps	Recommend 4 mm <sup>2</sup> as a standard up to 10 kWp and 6 mm <sup>2</sup> for larger




## Study Results: Operation and Maintenance

Monitoring		Cleaning	
Best performing systems use remote monitoring	Best performing systems have maintenance Contract	High Impact of dust and dirt	Insufficiently maintained inverter
			
<ul style="list-style-type: none"> <li>Mandatory remote monitoring</li> </ul>	Introduce mandatory maintenance contract with annual inspection	<ul style="list-style-type: none"> <li>Weekly cleaning</li> <li>Introduce mandatory instructions to owners by installer</li> </ul>	Educate on the negative impact of congested ventilation



# PV rooftop distributed generation offsets peak demand

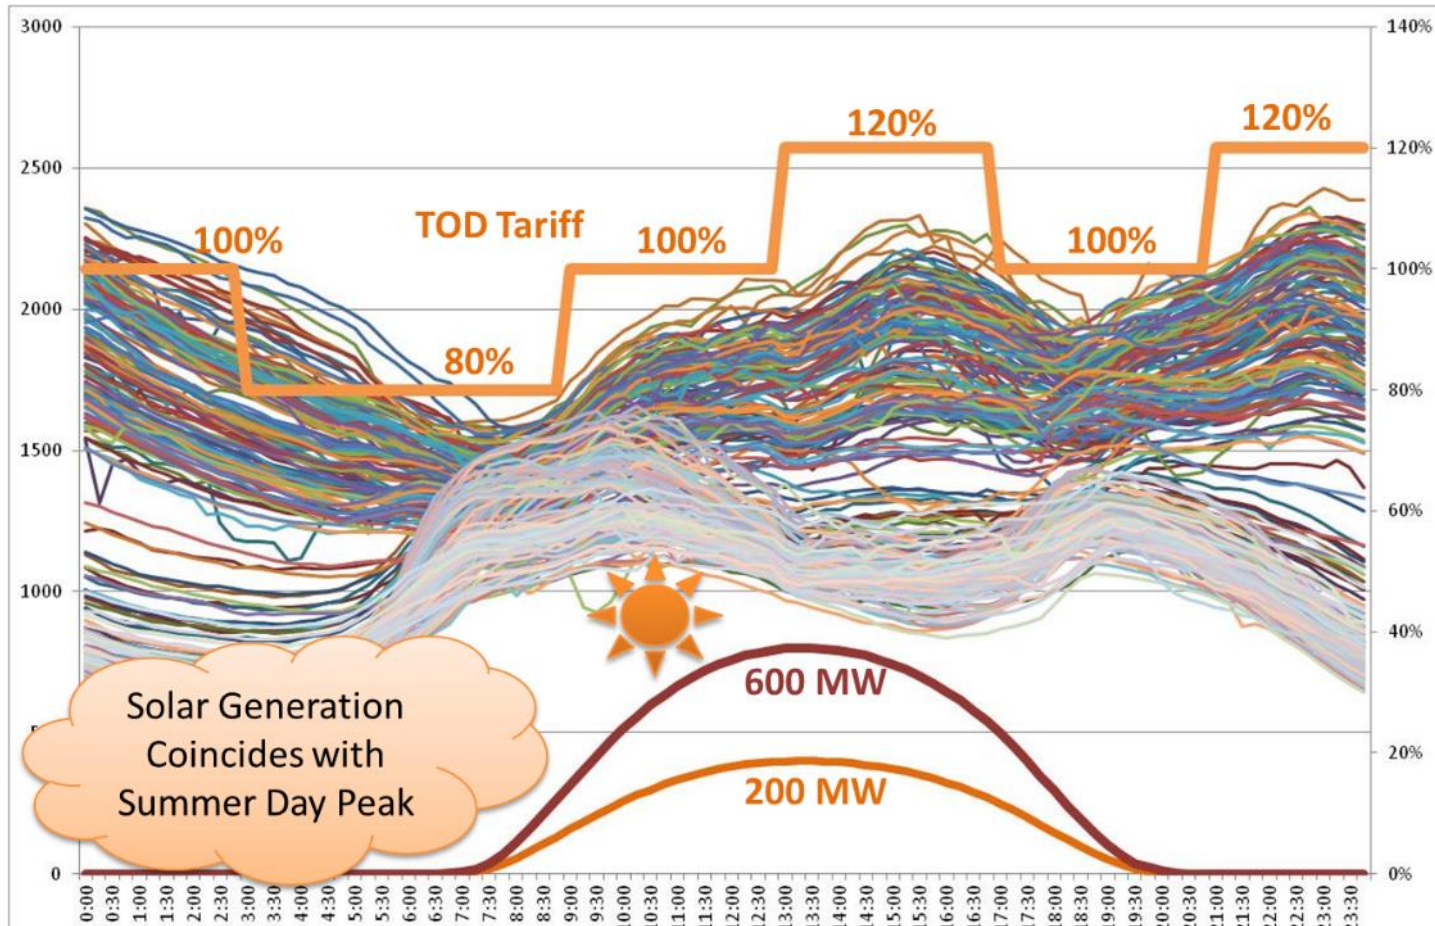

**Peak Support, stabilise grid, reduce AT&C loss**



The survey report is available at [www.comsolar.in](http://www.comsolar.in)

## Rooftop Solar Project Indo German Energy Programme

As a federal enterprise, GIZ supports the German Government in achieving its objectives in the field of international cooperation for sustainable development.

### Published by

Deutsche Gesellschaft für  
Internationale Zusammenarbeit (GIZ) GmbH

Registered offices, Bonn and Eschborn, Germany

Indo-German Energy Programme

B-5/2, Safdarjung Enclave  
New Delhi – 110 029, India

T +91 11 4949 5353

F +91 11 4949 5391

E [Joerg.gaebler@giz.de](mailto:Joerg.gaebler@giz.de) ; [abhinav.goyal@giz.de](mailto:abhinav.goyal@giz.de)

I [www.giz.de](http://www.giz.de)

**Responsible**  
Joerg Gaebler

**Project Manager**  
Abhinav Goyal

**Consultant**  
Jan Stasik

**Participant's**  
Sadaf Shah  
Dirk Simon